


REVISION No. 8

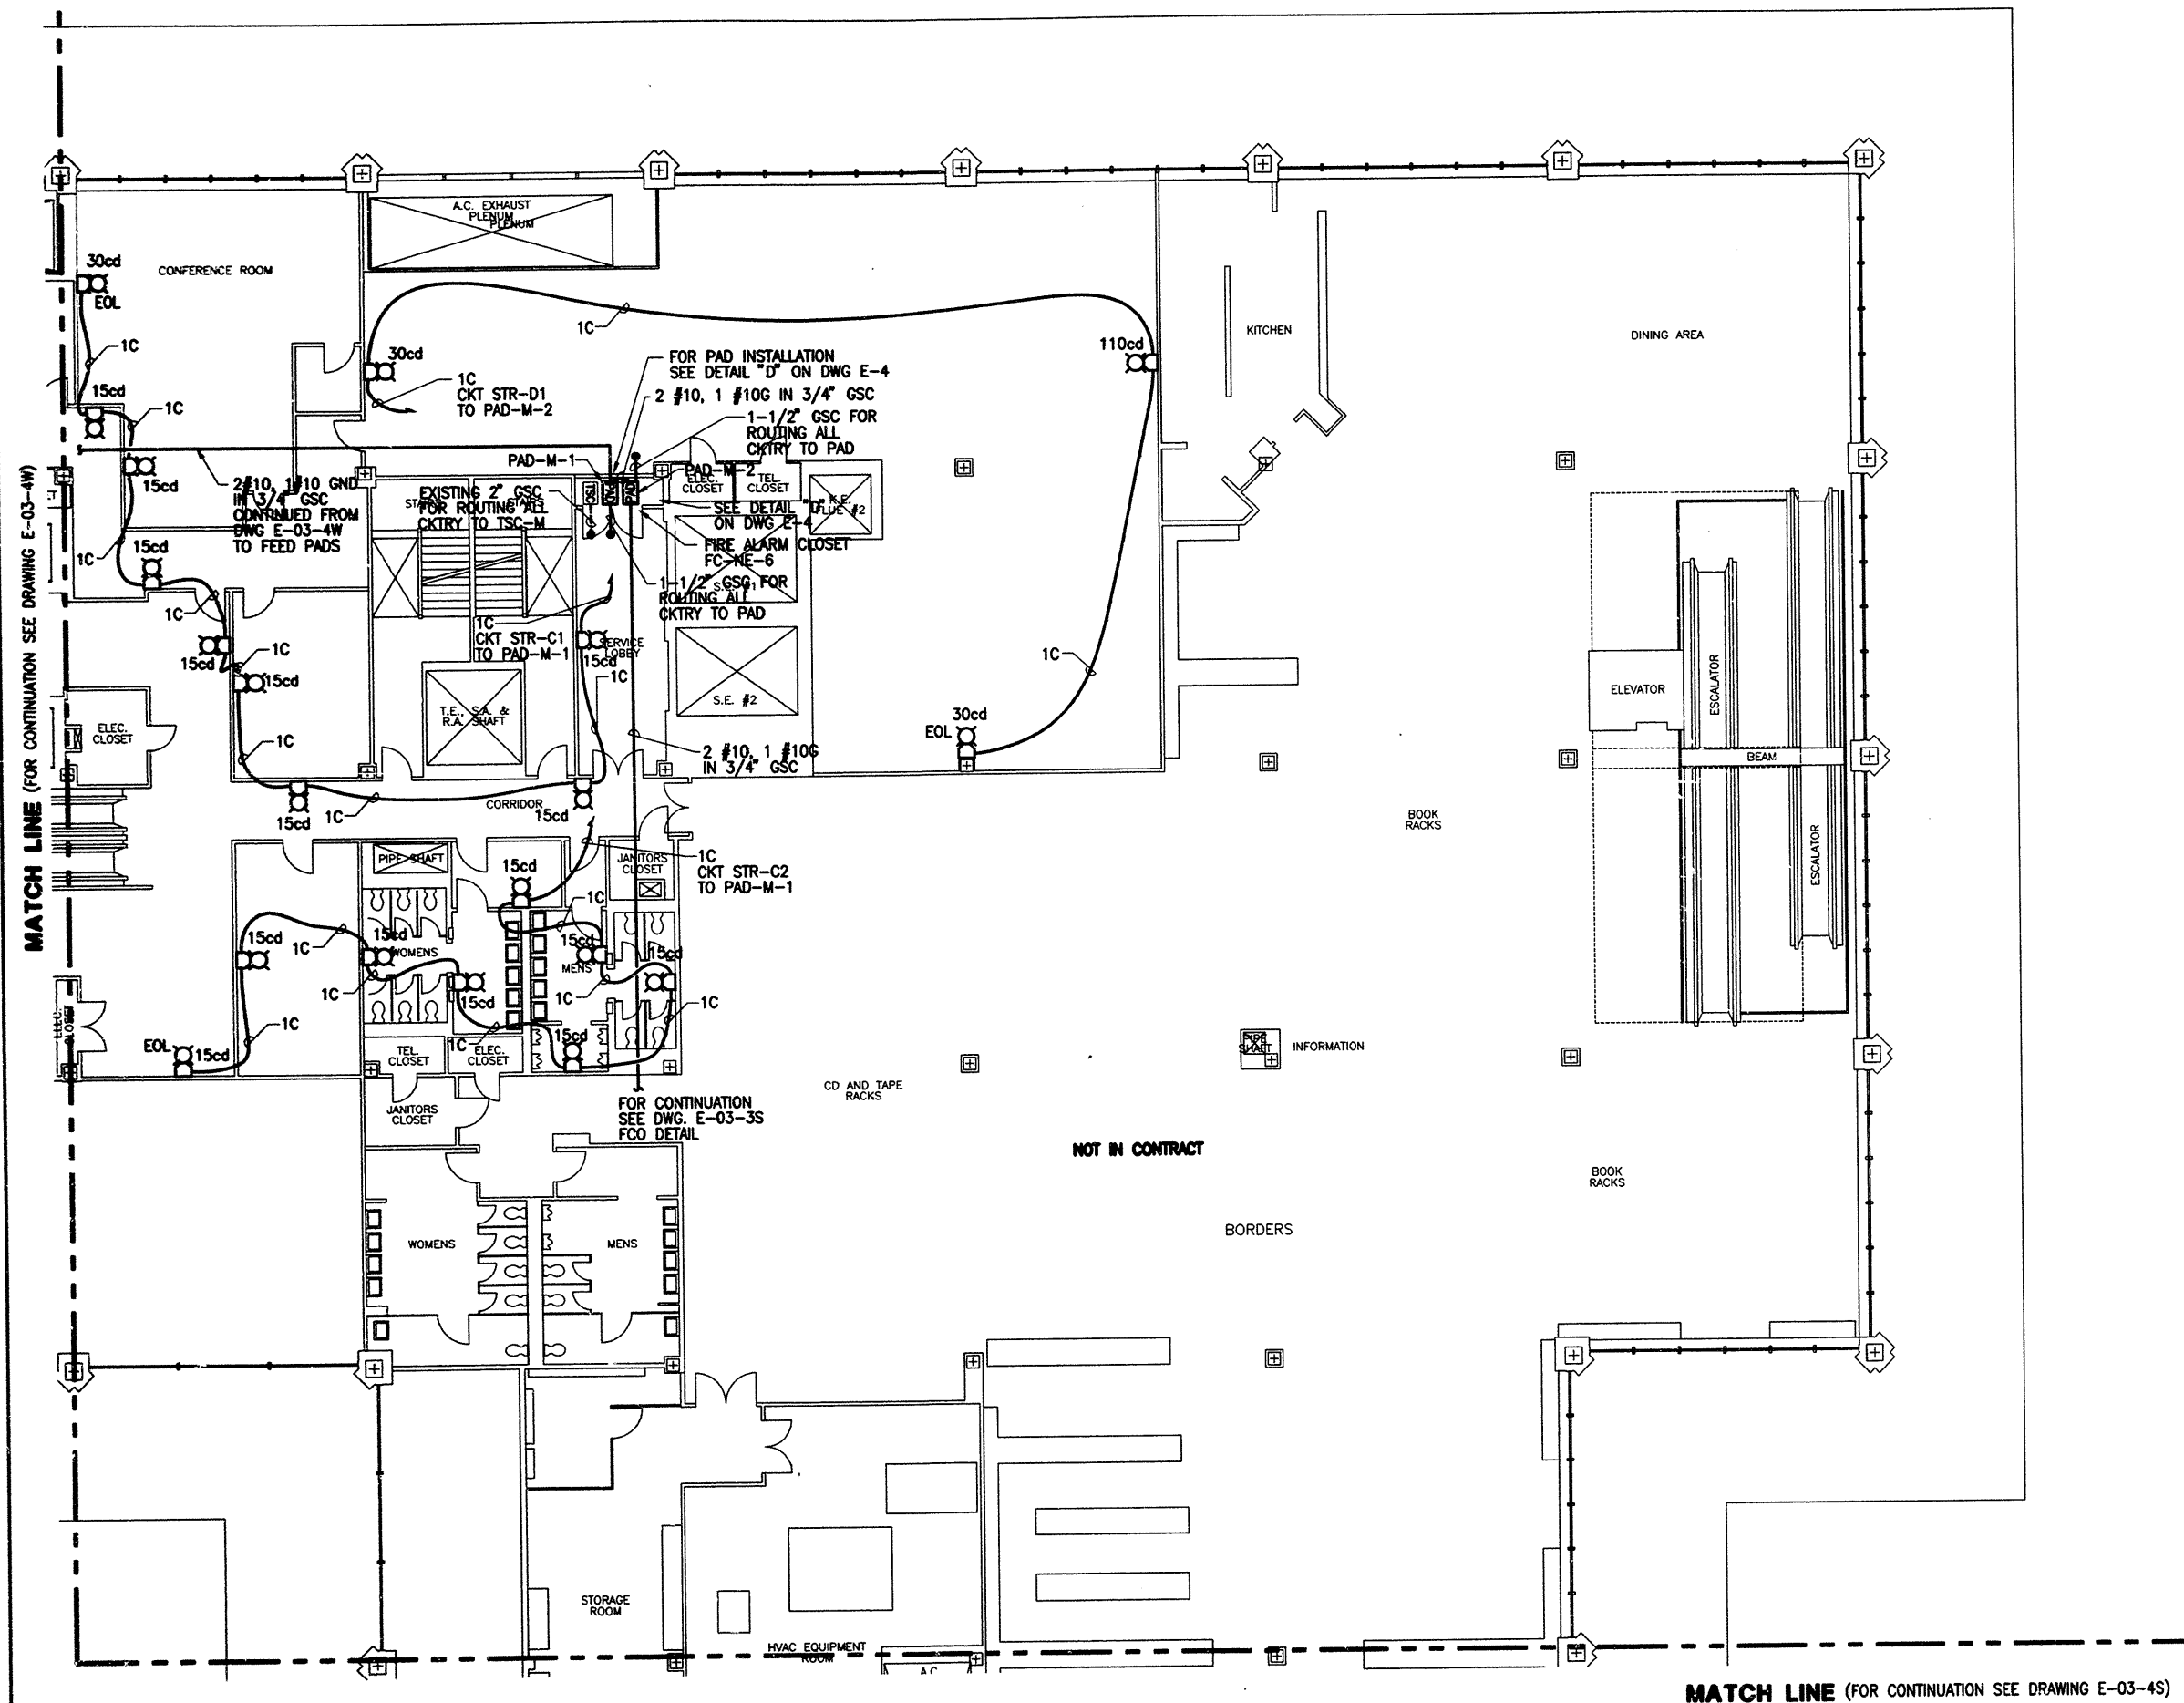

NOTES

1. FOR LEGEND, ABBREVIATIONS, AND GENERAL NOTES, SEE DWG. E-1. FOR INSTALLATION DETAILS, SEE DWGS. E-2 AND E-4. FOR WIRING DIAGRAMS, SEE DWGS. E-3 AND E-4.
2. NOT USED
3. NOT USED
4. NOT USED
5. NOT USED

Sheet 16 of 84

THE PORT AUTHORITY
OF NEW YORK AND NEW JERSEY

[Signature]
ENGINEERING PROGRAM MANAGER
WORLD TRADE
CENTER
CHIEF ELECTRICAL ENGINEER

No. Date Revision Approved

ENGINEERING DEPARTMENT

WORLD
TRADE
CENTER

ELECTRICAL

Title
FIRE ALARM SYSTEM
DEVICE UPGRADE
PHASE III
5 WTC 3rd, 4th, 5th & 6th FLOORS

3rd FLOOR
STROBE LAYOUT
INSTALLATION
EAST PART PLAN

This drawing subject to conditions in Contract. All inventions, ideas, designs and methods herein are reserved to Port Authority and may not be used without its written consent.

S. FELDSTEIN S. ANSINE A.S.
Designed by Drawn by Checked by

NOVEMBER 26, 1999
Date

WTC-861.573 E-03-4E
Contract Number Drawing Number

I HEREBY CERTIFY THAT THIS IS A TRUE AND CORRECT COPY OF ONE OF THE CONTRACT DRAWINGS CONSTITUTING A PART OF CONTRACT NO. WTC-861.573 IN THE FORM IN WHICH SAID DRAWINGS EXISTED AT THE TIME THE SAID CONTRACT WAS EXECUTED BY THE PARTIES.
DATE 11/1/00 *[Signature]* CONTRACT ENGR./ARCHT.
DATE 11/1/00 *[Signature]* ENGINEERING PROGRAM MGR.

